

What's New in C37.113-2015

IEEE Guide for Protective Relay Applications to Transmission Lines

2017 Western Protective
Relay Conference

History

- Revision of C37.113-1999
- Application of relays and protection systems to protect transmission lines
- D19 Working Group of IEEE Power System Relaying and Control (PSRC) Committee
- 31 working group members
- Approved on December 5, 2015

C37.113-2015 (D19 WG) members

- Don Lukach - Chair
- Jeffrey Barsch – Vice Chair
- Martin Best
- Gustavo Brunello
- David Circa
- Stephen Conrad
- Randall Cunico
- Alla Deronja
- Normann Fischer
- Dom Fontana
- Gary Kobet
- Walter McCannon
- Alexis Mezco
- Dean Miller
- John Miller
- Joe Mooney
- James O'Brien
- Dean Ouellette
- Claire Patti
- Elmo Price
- Sam Sambasivan
- Mohindar Sachdev
- Phil Tatro
- Richard Taylor
- Michael Thompson
- Ian Tualla
- Demetrios Tziouvaras
- Jun Verzosa
- Solveig Ward
- Roger Whittaker
- Zhiying Zhang

Summary Paper D36 WG members

- Jeffrey Barsch - Chair
- Don Lukach - Vice Chair
- Laura Agudelo
- Jay Anderson
- Gustavo Brunello
- Don Burkart
- David Busot
- Nestor Casilla
- Randall Cunico
- Dom Fontana
- Rafael Garcia
- Binaya Joshi
- Gary Kobet
- Walter McCannon
- John Miller
- Joe Mooney
- Manish Patel
- Claire Patti
- Greg Ryan
- Ian Tualla
- Looja Tuladhar
- Joe Uchiyama
- Umer Usman
- Roger Whittaker
- Karl Zimmerman

Table of Contents

- Definitions, abbreviations, and acronyms
- Fundamentals
- Impact of system configuration on selection of protection schemes
- Relay schemes
- Annex and extensive bibliography

What's New?

- Communication systems; Redundancy; Autoreclosing
- Ground overcurrent protection; Line length considerations
- Lines terminated into transformers
- Current differential applications; Ground path configurations
- Effects of high grounding resistance


What's New (continued)?

- Transfer and stub bus configurations
- Relay elements used in step distance schemes
- Polarization methods
- Specially shaped characteristics
- Single-phase tripping and reclosing
- Fault and system studies

Communications


- Communications allows for high-speed clearing
- Considerations when choosing a communication-based scheme

Redundancy and Backup Considerations

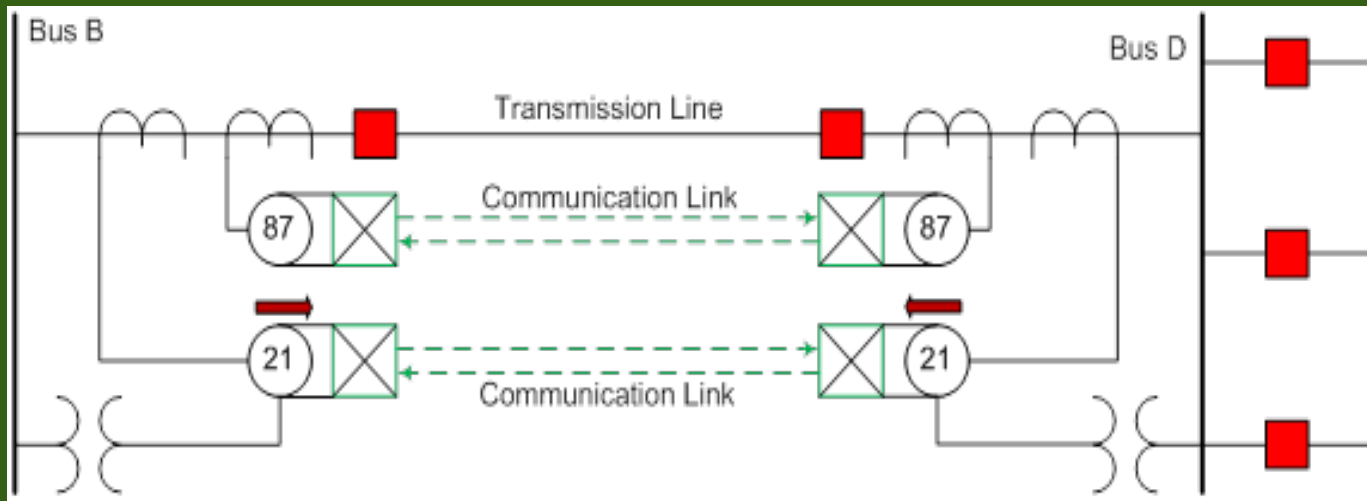

Main 1 and main 2 systems for protecting a transmission line

Remote backup protection of a transmission line

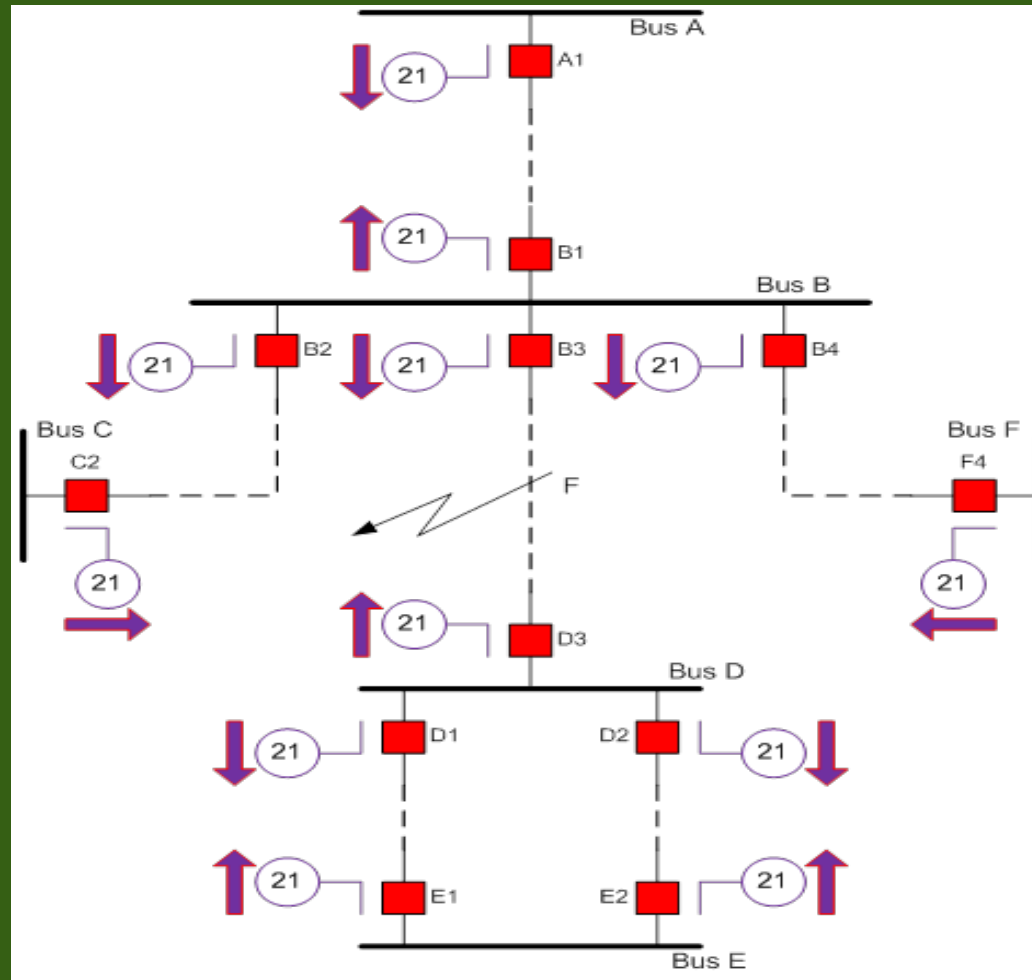

Autoreclosing methods

- IEEE Std C37.104
- Discusses criteria used for selecting autoreclosing schemes
- High-speed and time-delayed are discussed


Sensitive ground OC fault protection

- High impedance faults pose challenge for distance relays
- Directional ground OC relays must balance sensitivity and security
- Considerations when using OC relays
- Coordination requirements


Line length considerations and SIR

- $SIR > 4$; short line
 - $0.5 \leq SIR \leq 4$; medium line
 - $SIR < 0.5$; long line
-
- Short lines pose challenge for line protection

Line length considerations and SIR

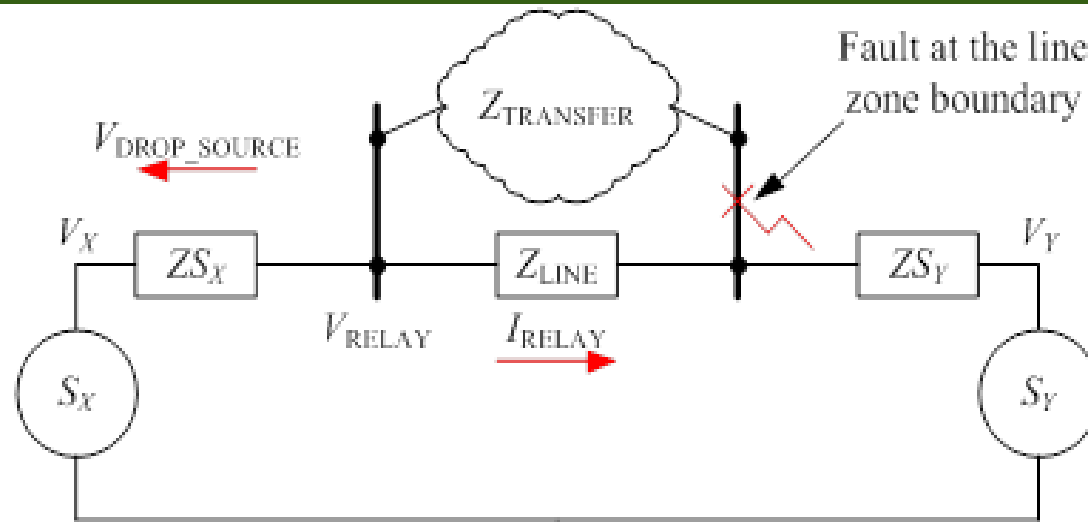


(a) Simplified System

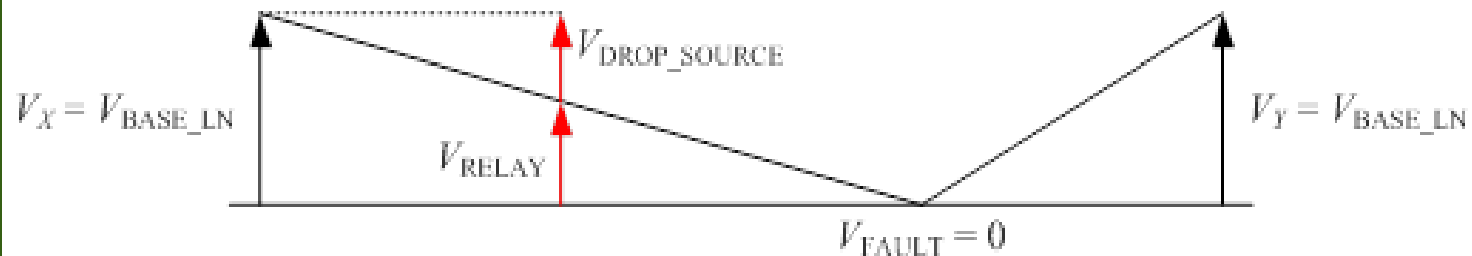


(b) Voltage Profile While Faulted

Considerations for Line Distance Applications

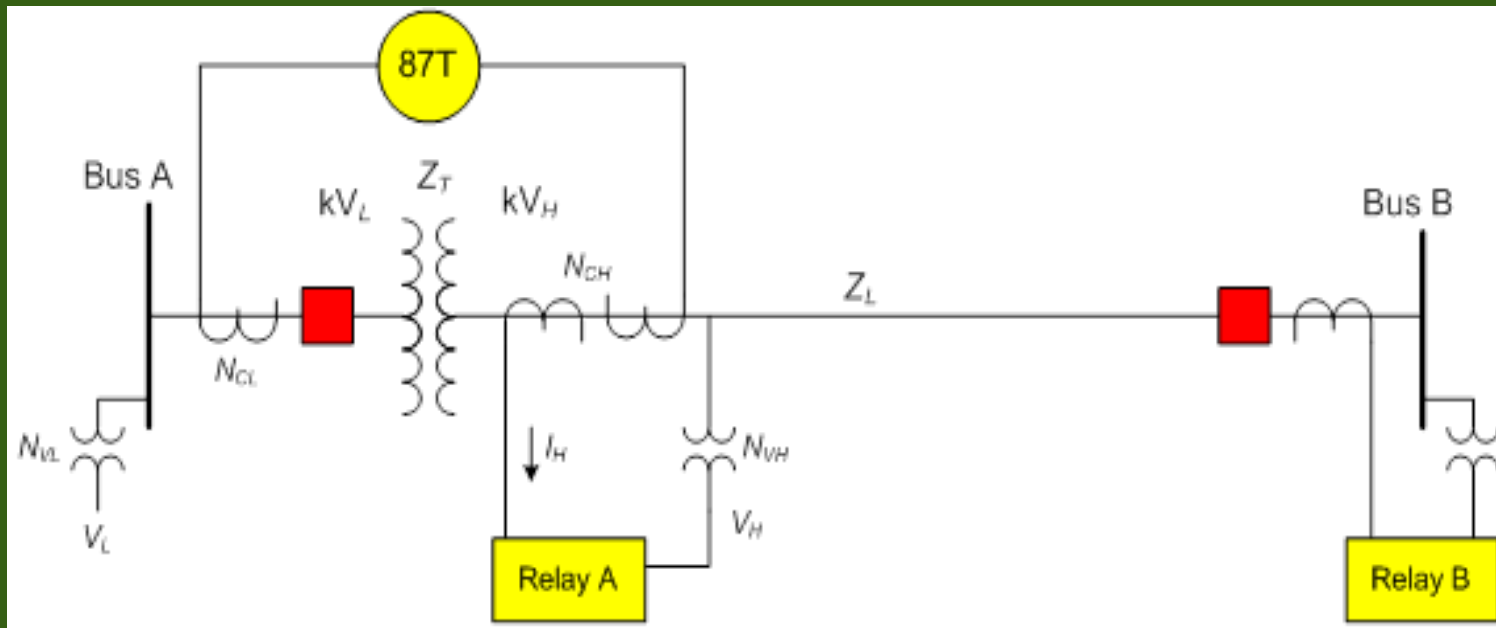

Preferred scheme for a line terminated into a transformer – Use V_H and I_H


Considerations for Line Distance Applications

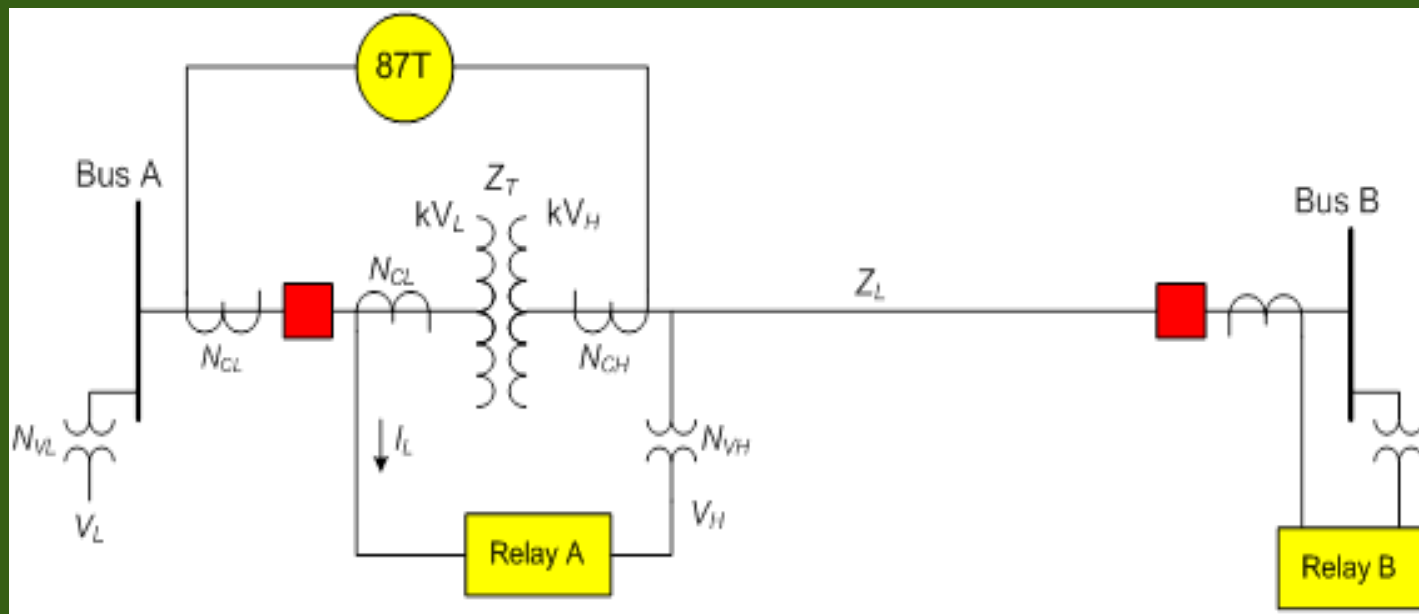

Relay uses V_H and I_L


$$Z_{SEC} = \frac{N_{CL} \frac{kV_L}{kV_H}}{N_{VH}} Z_{PRI}$$

Considerations for Line Distance Applications

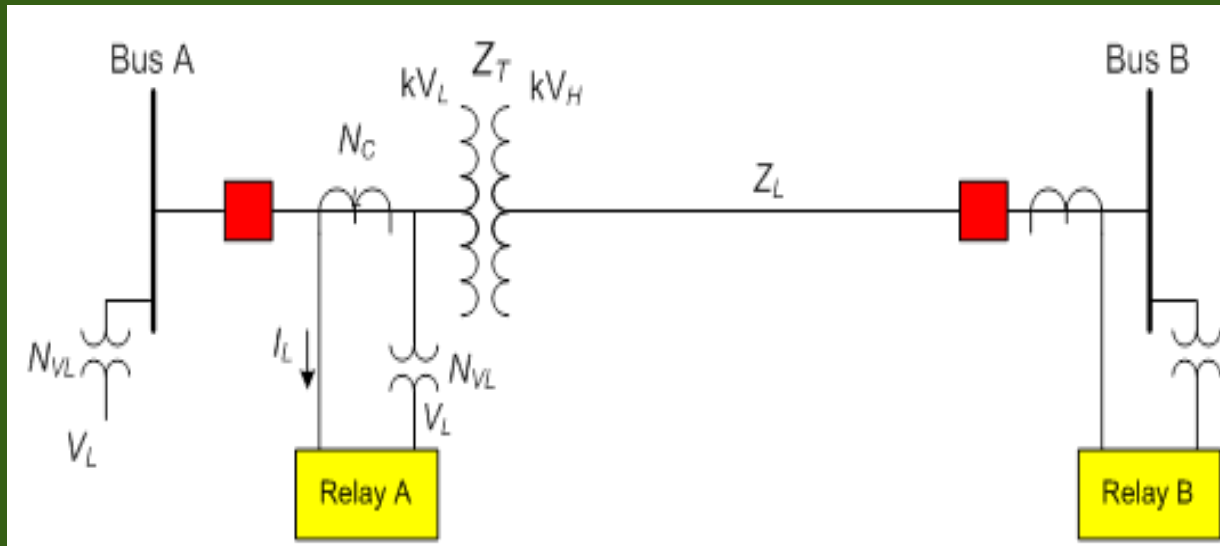

Relay uses V_L and I_L

Considerations for Line Distance Applications

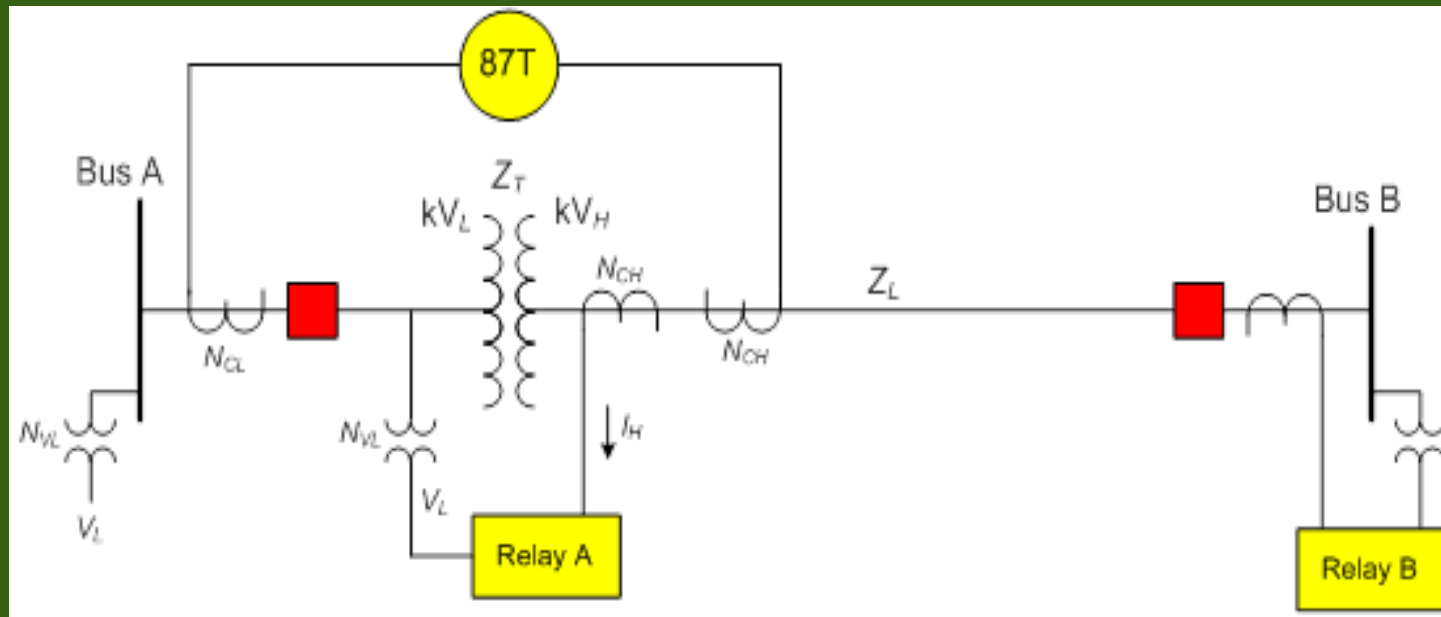


Relay uses V_L and I_H

$$Z_{SEC} = \frac{N_{CH} \frac{kV_H}{kV_L}}{N_{VL}} Z_{PRI}$$


Current differential applications for lines terminated into transformers

- No issues if current I_H is used
- If I_L is used, consider:
 - Phase shift correction
 - Zero-sequence filtering


Ground path configurations

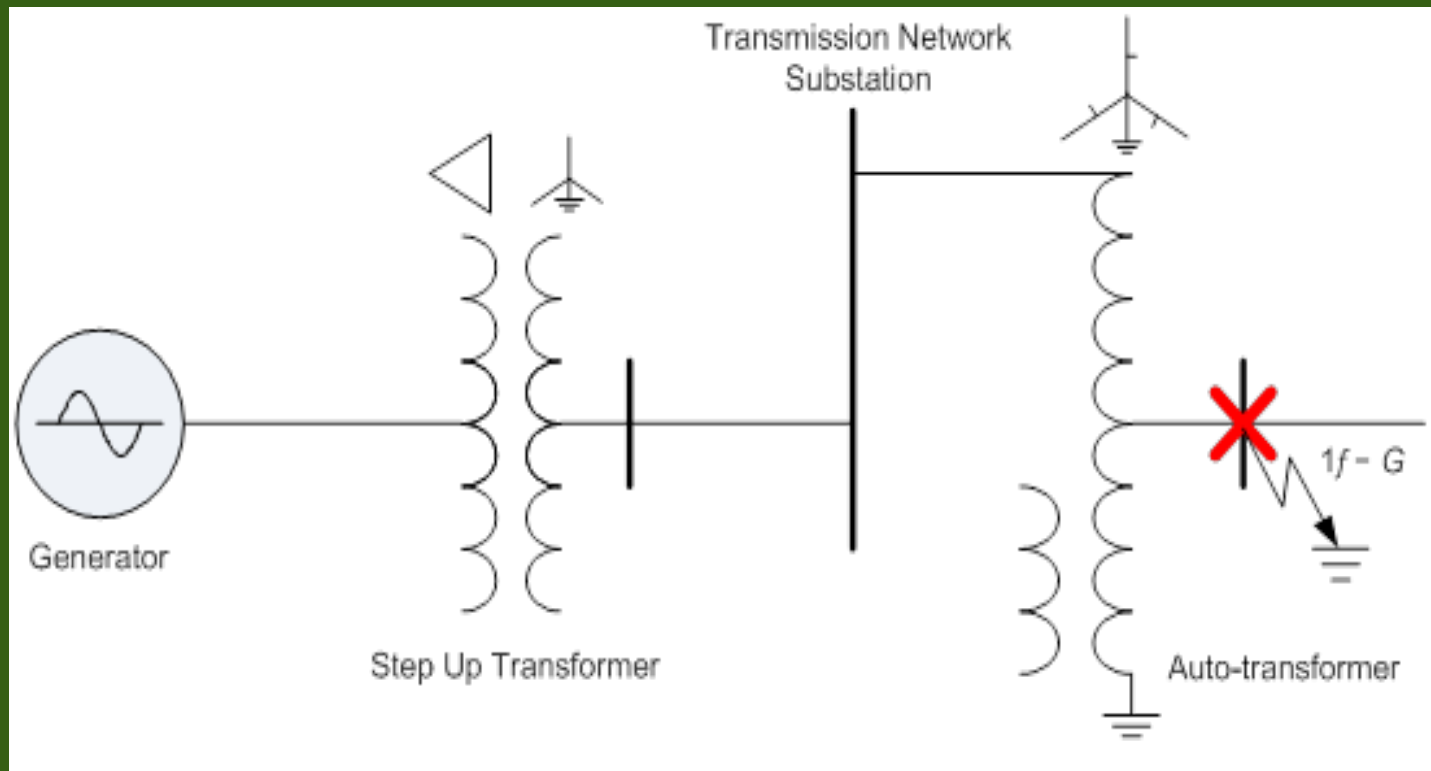

Symmetrical component diagram

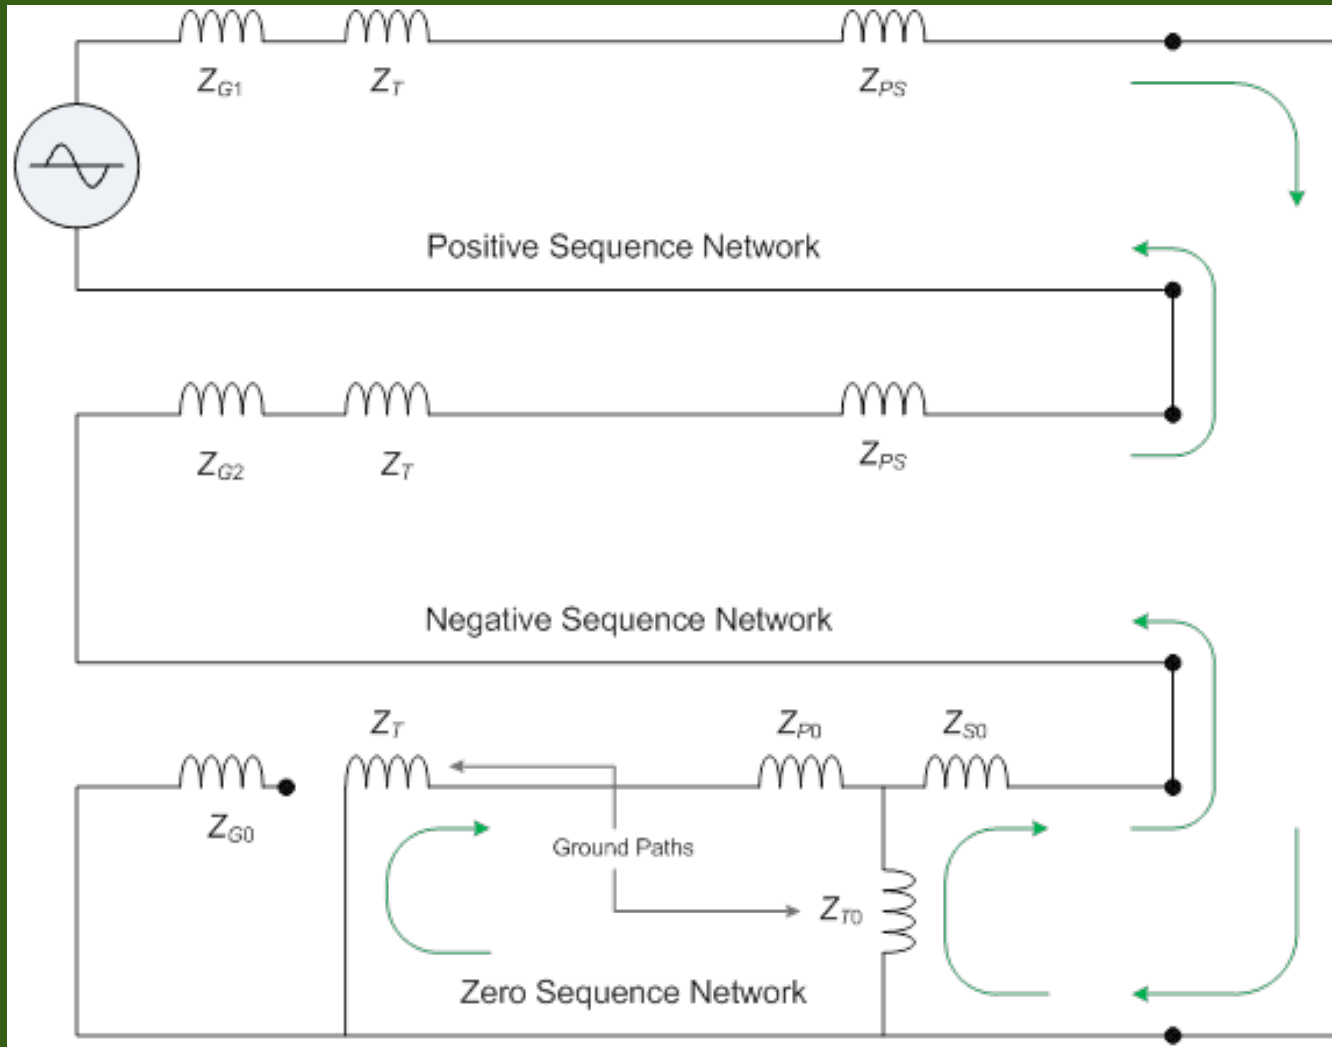

Zero-sequence current flow

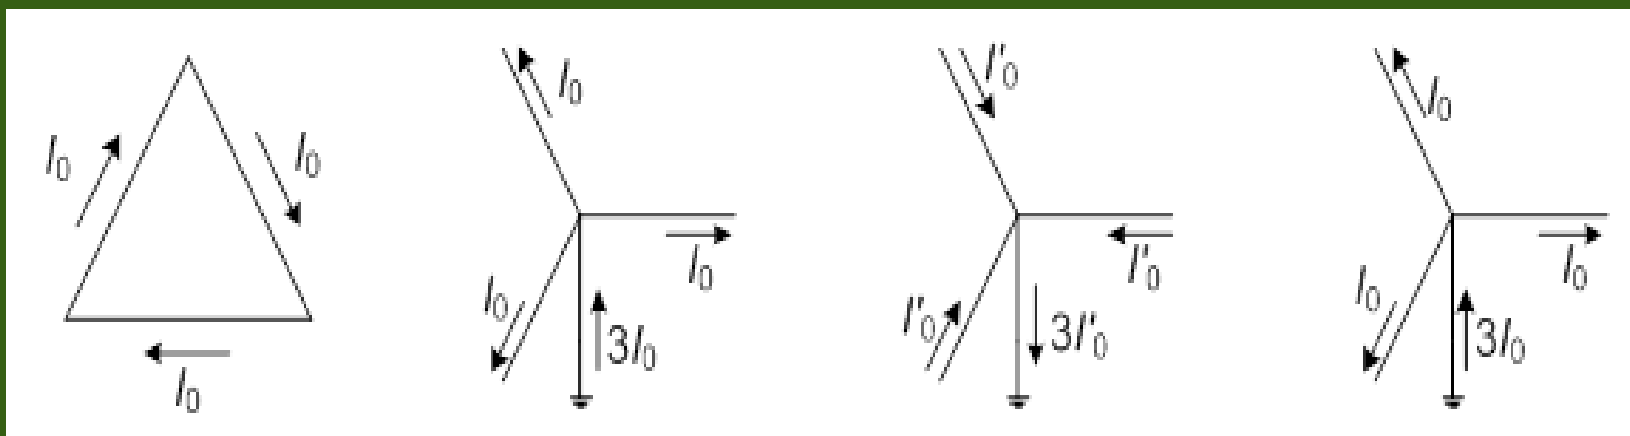


(a)

Delta to wye-grounded
transformer


(b)

Wye-grounded to wye-grounded
transformer

Effects of high grounding resistance on operation of line protection

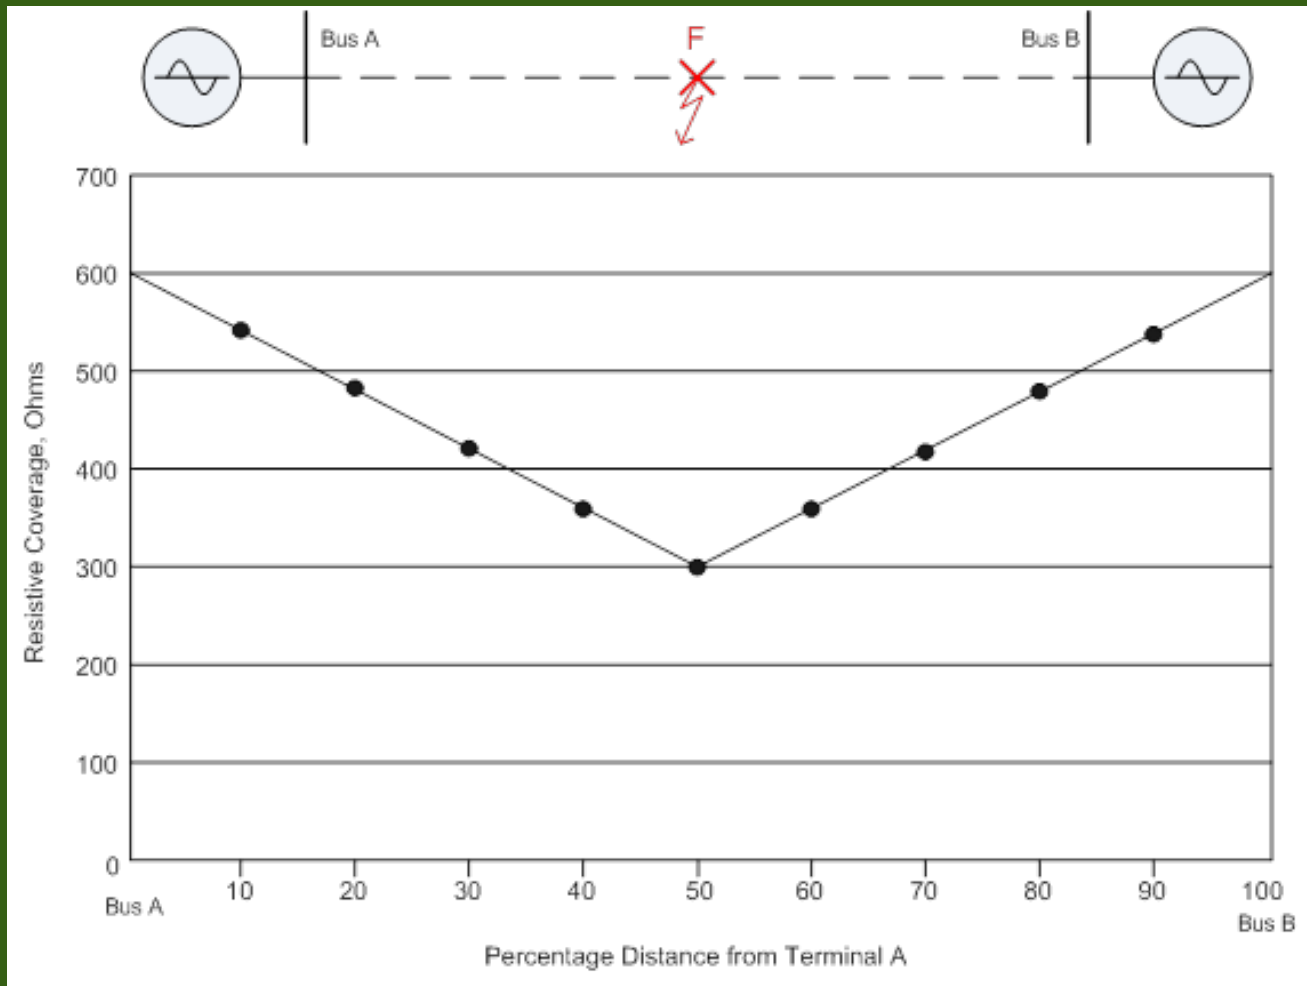

Transfer bus and stub bus configurations

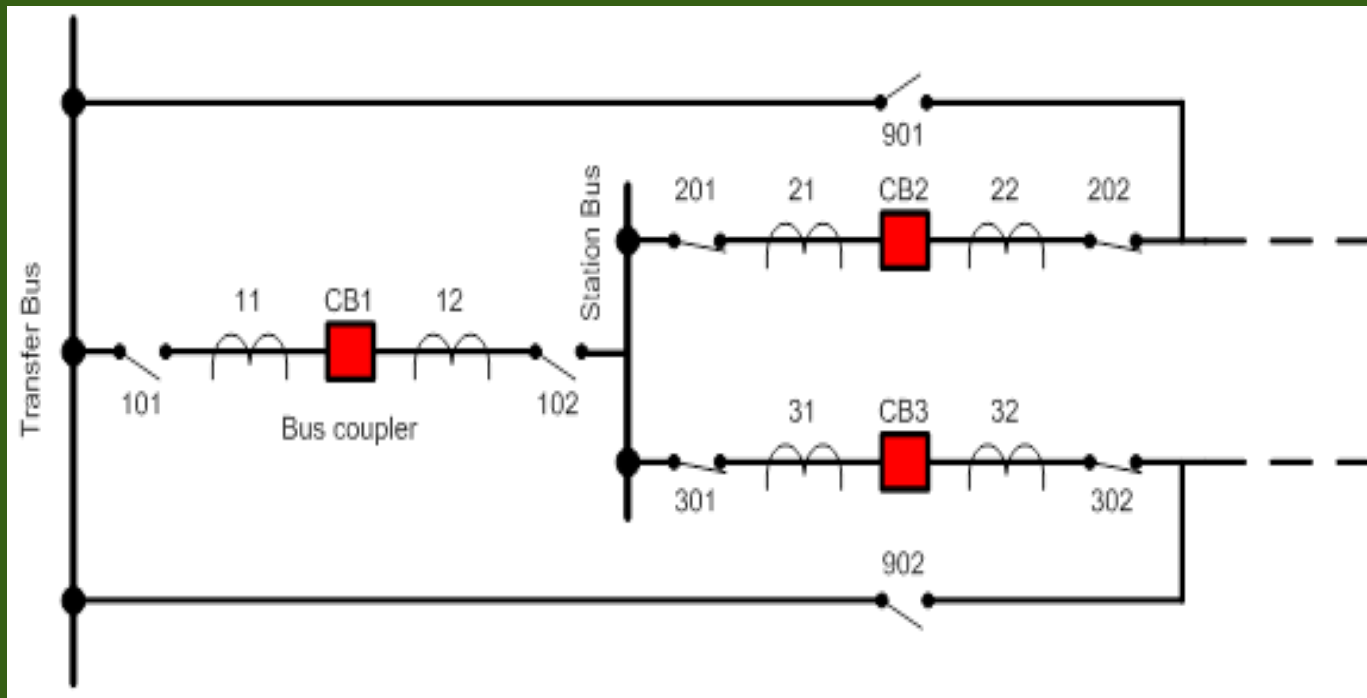

Transfer bus configuration

Relay elements in step distance schemes


- Use positive-sequence impedance in step distance schemes
- Three relay elements are needed for detecting multiphase or single-phase-to-ground faults

Relay element	Type of fault	Voltage applied	Current applied
1	A-ground	V_A	$I_A + 3I_0k$
2	B-ground	V_B	$I_B + 3I_0k$
3	C-ground	V_C	$I_C + 3I_0k$


$$k = (Z_0 - Z_1) / (3Z_1)$$

Directional ground overcurrent relay polarization methods


- Various methods are discussed
- Importance of using matching polarizing methods

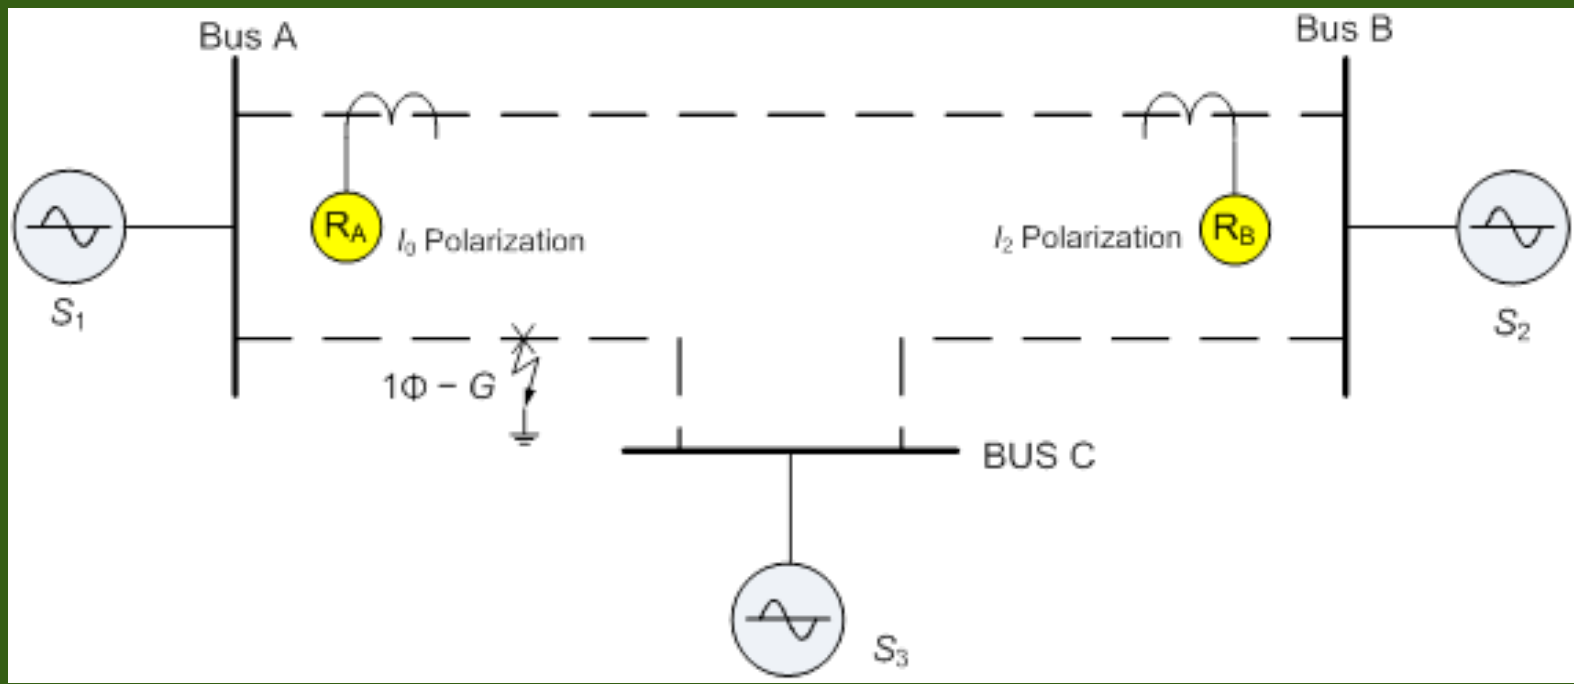


Specially shaped characteristics

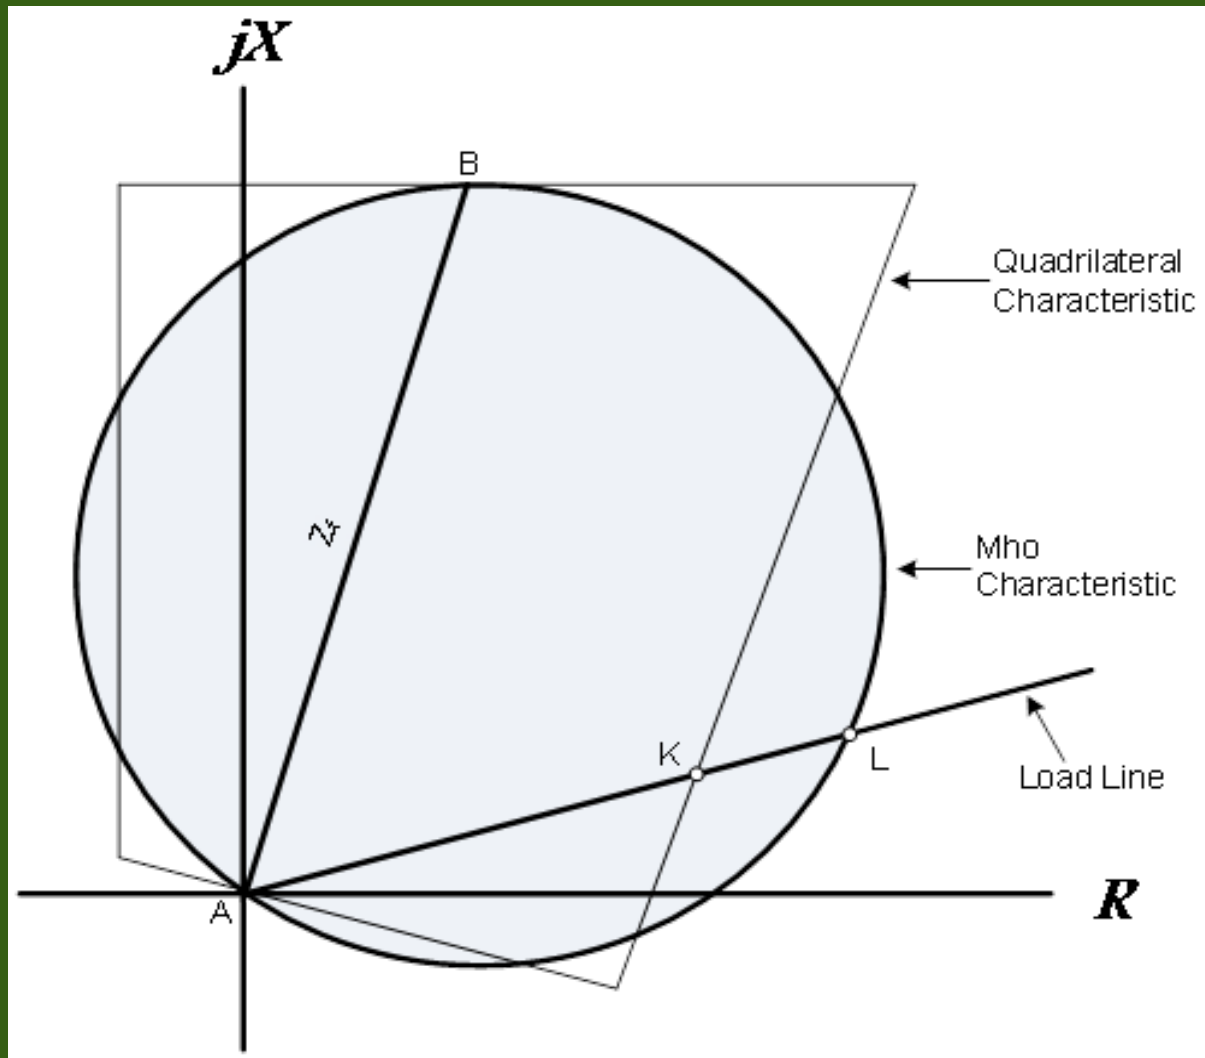

Cone-type load blinder

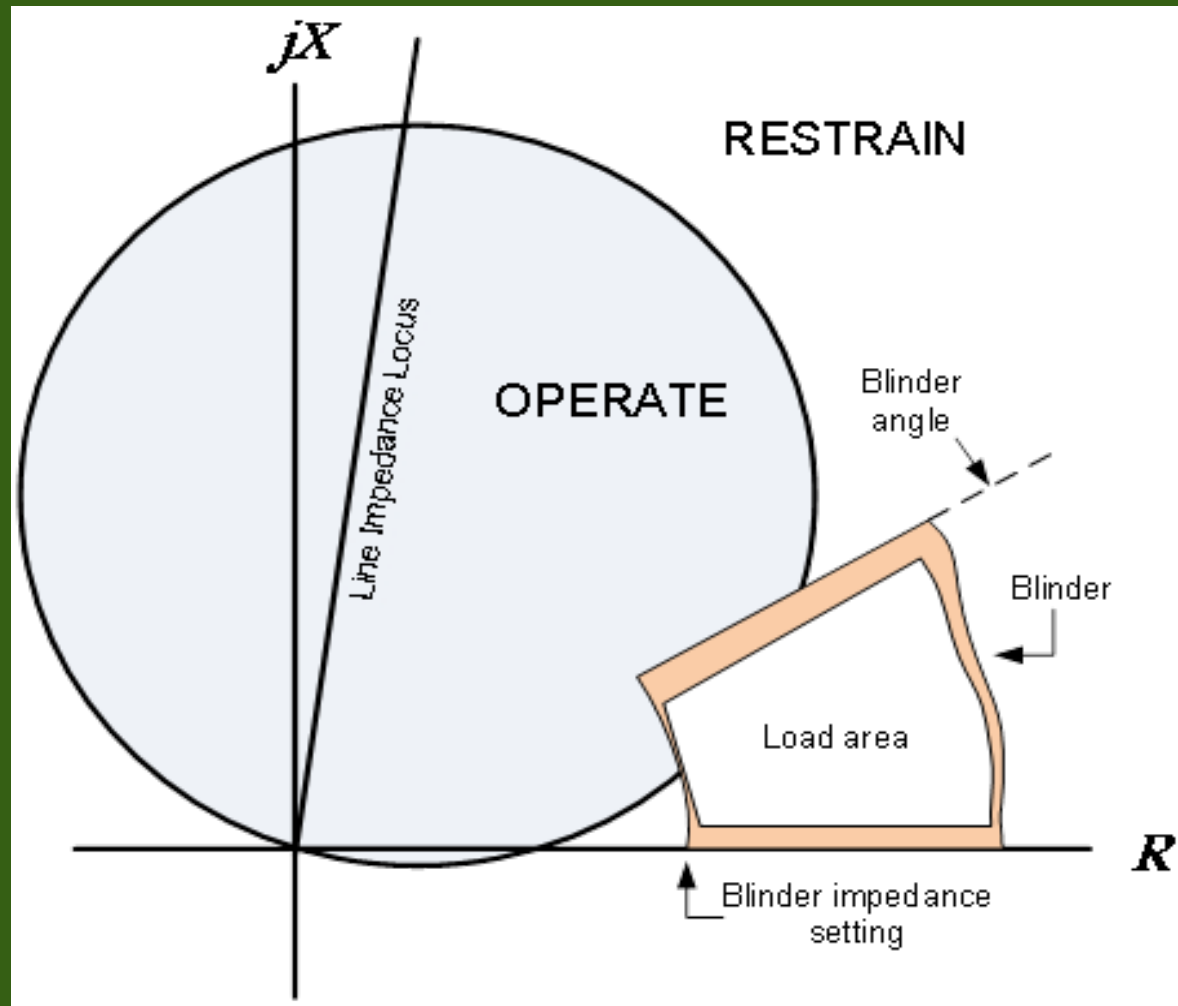


Load blinders and lenticular characteristic

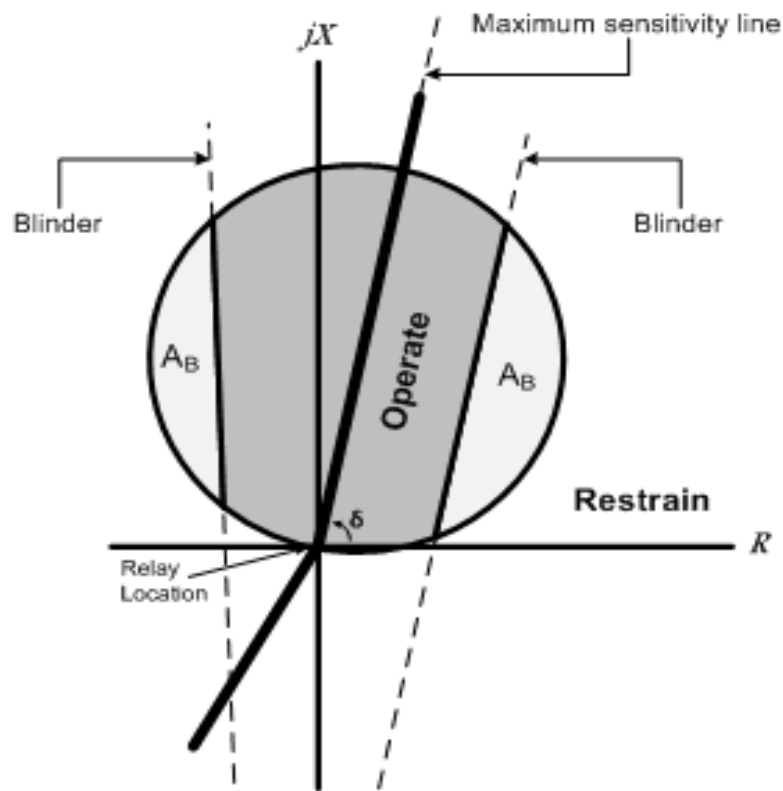

AB is the area of characteristic blocked to accommodate load encroachment

(a) Mho relay with two load blinders

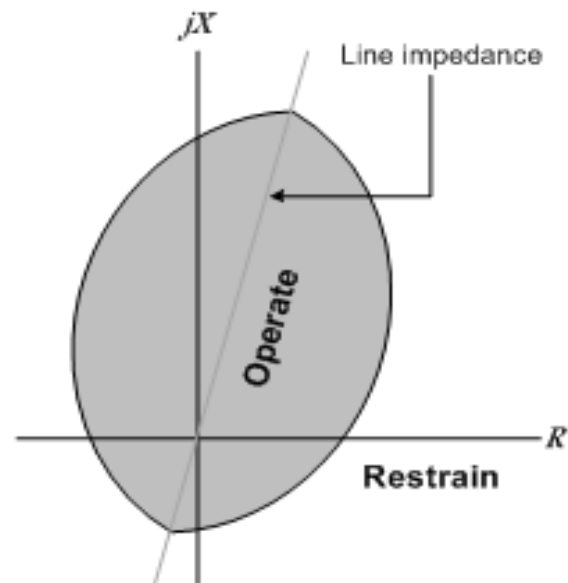

(b) Lenticular characteristic

Role of directional ground OC relays with ground distance relays

- Directional ground OC can provide sensitive protection for ground faults
 - Directional comparison pilot schemes
- Load and system imbalance
- A secure approach is to coordinate all ground elements with each other

Single-phase tripping and reclosing

- SLG fault -> Trip faulted phase
- Multi-phase fault -> Trip all phases
- Benefits:
 - Typically improves stability and power transfer capability
 - Improved system response
 - Lower power surges for generators
 - Do not need to check for synchronism on reclose
 - Reduced switching overvoltages

Single-phase tripping and reclosing

– Special considerations

- Faulted phase selection
- Arc deionization
- Automatic reclosing considerations
- Pole disagreement
- Effects of unbalanced currents
- Extra requirements for circuit breakers and relays

Questions

???